


REVISIONS

DESCRIPTIONS	BY	DATE	APPROVED

MINIMUM PAVEMENT DEPTHS ARE AS FOLLOWS:
 LOCAL STREETS 4" (2 LIFTS)
 COLLECTOR STREETS 5" (2 LIFTS)
 ARTERIAL STREETS 6" (3 LIFTS)
 LIFTS SHALL BE PLACED IN DEPTHS NOT TO EXCEED
 2.5 INCHES

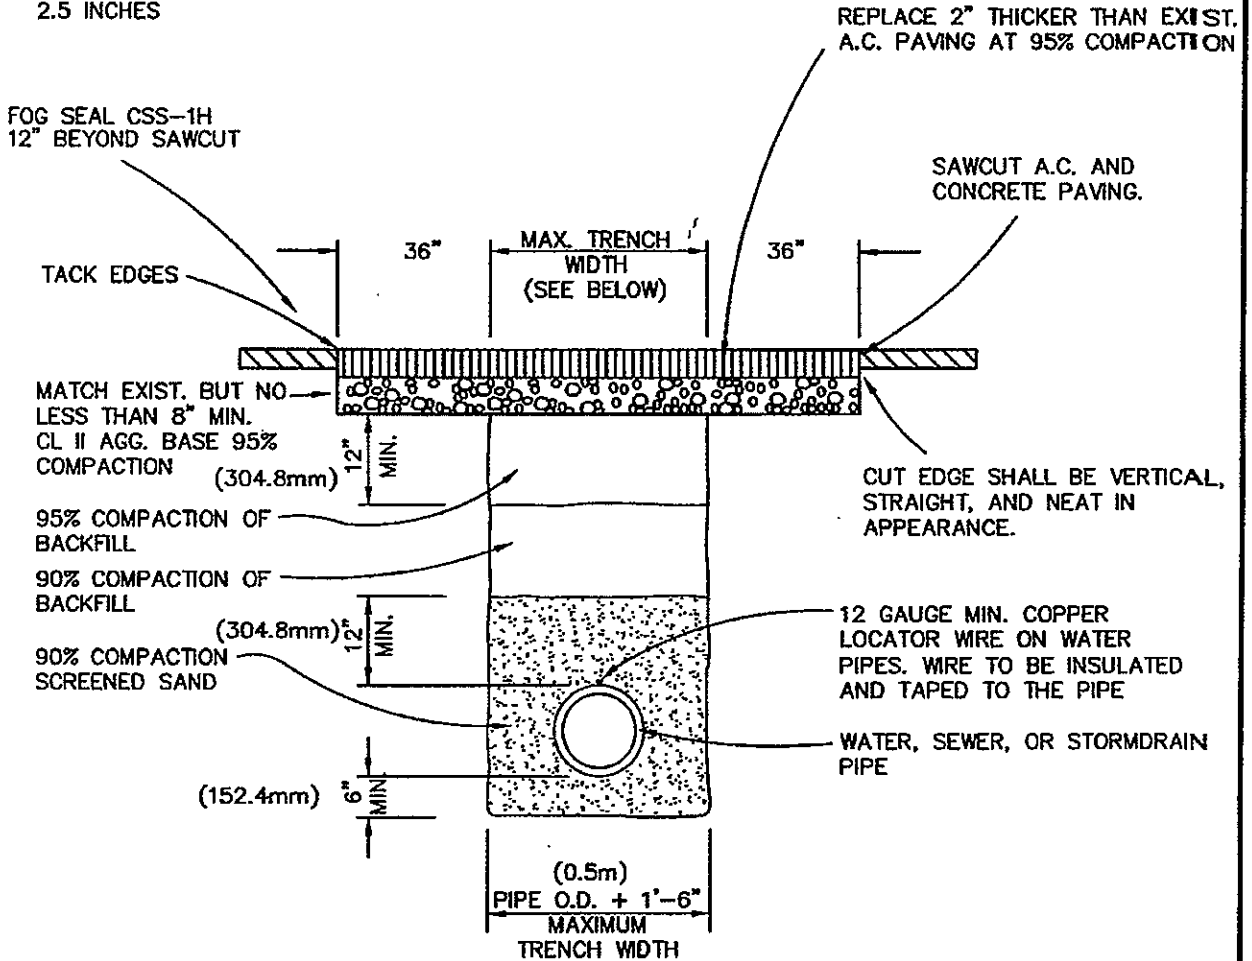

NOTES:

1. No. 12 AWG LOCATOR WIRE REQUIRED ON ALL WATER MAINS AND SERVICES, TAPED TO TOP OF PIPE (AND SEWER FORCE MAINS).
2. NO ROCKS OR OLD PAVEMENT MAY BE DEPOSITED WITH BACKFILL.
3. SEE STANDARD U-2A FOR TEMPORARY PATCHES.
4. FINISH SURFACE SHALL MATCH EXISTING GRADE WITH A TOLERANCE OF 0.25 INCHES ABOVE ADJACENT GRADE.
5. A SEPARATE CITY RIGHT-OF-WAY ENCROACHMENT PERMIT IS REQUIRED.

DRAWN BY: JAC
DESIGNED BY:
DATE: 12/01/03
FILE NAME: PR-U-2.DWG

CITY OF PASO ROBLES ENGINEERING DIVISION	
PIPE IN TRENCH DETAIL	

DRAWING NO. U-2
