

REVISIONS			
DESCRIPTIONS	BY	DATE	APPROVED

RAIN GUARD (W.C.S.-RG)  
FLUSH W/TOP OF HOUSING.  
1/2"x3" GALV. STEEL NIPPLE  
AND ELBOW W/ 1/2" FLANGE  
BOLTED TO HOUSING

CONNECT WIRES FROM  
RAIN GUARD TO MASTER  
VALVE OR PUMP START  
POWER POST

(USE VANDAL PROOF  
ENCLOSURE-W.C.S. RG VR)

WALL TYPE CONTROLLER  
MOUNTED INSIDE  
ENCLOSURE

ELECTRICAL METER TO BE  
PROVIDED BY IRRIGATION  
CONTRACTOR

CONTRACTOR IS TO PROVIDE  
ENCLOSURE MYERS No. MEUS-1-M  
WITH MOUNTING BASE INSTALL AS  
PER MANUFACTURERS RECOMMEN-  
DATION


ELECTRICAL CONDUIT TO SOURCE  
TO BE PROVIDED BY DEVELOPER

CONCRETE FOOTING - INSTALL 3"  
MIN. ABOVE FINISH GRADE AND  
SLOPE CONCRETE AT 2% TO DRAIN

1 CONTROL WIRE TO EACH R.C.V

1 COMMON WIRE TO ALL R.C.V.'S

CONTROL WRING

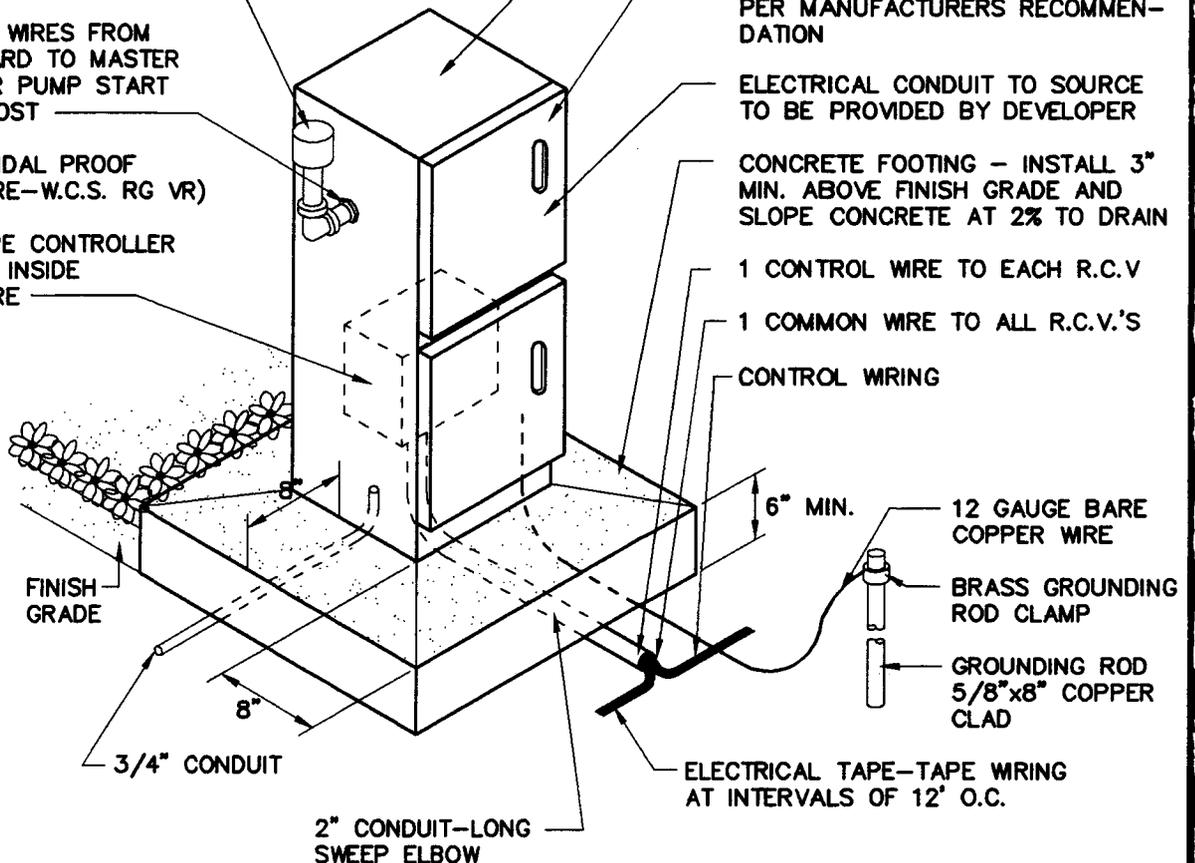

**NOTES:**

1. COMMON WIRE TO BE WHITE & CONTROL WIRE TO BE BLACK IN COLOR UNLESS OTHERWISE NOTED.
2. NO SPLICES SHALL BE MADE BETWEEN CONTROLLER & REMOTE CONTROL VALVE UNLESS OTHERWISE APPROVED.
3. CONTROL WRING SEQUENCE CORRESPONDS TO OPERATING SEQUENCE OF REMOTE CONTROL VALVES & AUTOMATIC SPRINKLER UNIT STATION CONNECTION-SEE IRRIGATION PLAN FOR CORRECT VALVE SEQUENCE.
4. WHEN USING RAIN GUARD LOCATE CONTROLLER IN A WAY NOT TO BE SPRAYED BY SPRINKLER.

DRAWN BY:  
C.A.C.  
DESIGNED BY:  
  
DATE:  
4/18/94  
FILE NAME:  
PR-L-3.DWG

CITY OF PASO ROBLES  
ENGINEERING DIVISION  
  
**ELECTRICAL METER (PEDESTAL)**

DRAWING NO.  
  
**L-3**